

SEDE

Via Martelli, 26 - 40138 **Bologna**
Tel. (051) 534015 - Fax. (051) 530085

CERTI.CER.

LABORATORIO DI ZONA

Via Valle d'Aosta, 1 - 41049 **Sassuolo**
Tel. e Fax. (0536) 802154

Part. IVA 0094778-0375

Bologna 20/03/08

Spett.le
FLOOR GRES CERAMICHE
Via Canaletto 24
41042 FIORANO (MO)

TEST LABORATORY

TEST REPORT N° 3567/08

concerning ceramic tiles according to EN 14411 (ISO 13006)

(translation of test report Nr. 7424/05 of 11/10/05)

Requested by:	FLOOR GRES CERAMICHE Via Canaletto 24 41042 FIORANO (MO)
On (date):	19/03/08
For the sample marked:	"Unglazed ceramic tiles - CHROMTECH 1.0 COOL 1.0 POINT 30x60 - Tono 50 A".

The results reported relate only to the samples tested.

No responsibility is taken for the accuracy of the sampling unless it is done under our supervision.

The reproduction of this test report is only authorized in the form of a complete photographic facsimile. Our written approval is necessary for any partial reproduction.

This test report consists of 3 pages this cover included.



Consorzio universitario per la gestione del
«Centro di ricerca e sperimentazione per
l'industria ceramica».

D.P.R. 10-4-1978 n. 806
(G.U. 20-12-1978 n. 353)

Laboratorio autorizzato ad effettuare il
servizio di rilevamento dell'inquinamento
atmosferico.

Decreto MINISTERO SANITÀ 10-9-1974
(G.U. 14-9-1974 n. 240)

Laboratorio iscritto nell'albo dei «Laboratori Esterni
Pubblici e Privati Altamente Qualificati».

Decreto MINISTERO RICERCA SCIENTIFICA 6-6-1983
(G.U. 6-7-1983 n. 183)

Membro ASTM

American Society for
Testing and Materials.

Test report N. 3567/08 Date 20/03/08

Page 2 of 3

Description of the sample:

Ceramic tiles 30 x 60,7 x 1,0 cm marked "Unglazed ceramic tiles - CHROMTECH 1.0 COOL 1.0 POINT 30x60 - Tono 50 A".

Manufacturer: -----

Sampling details:

- Where: -----
 - Date: -----
 - By whom: CUSTOMER
 - How (methods): -----

DATE OF RECEIVAL IN LABORATORY: 07/10/05

TESTS PERFORMED:

		Date of starting	Date of ending
<input checked="" type="checkbox"/>	DIN 51130 Determination of the anti - slip properties - (06/2004) Workrooms and fields of activities with raised slip danger, walking method - ramp test	10/10/05	10/10/05


**DIN 51130 (06/2004)- Determination of the anti - slip properties –
Workrooms and fields of activities with raised slip danger, walking
method – ramp test**

Surface characteristics

- Smooth
- Profiled
- Structured
- Rough

OPERATIVE CONDITIONS

Fixing scheme

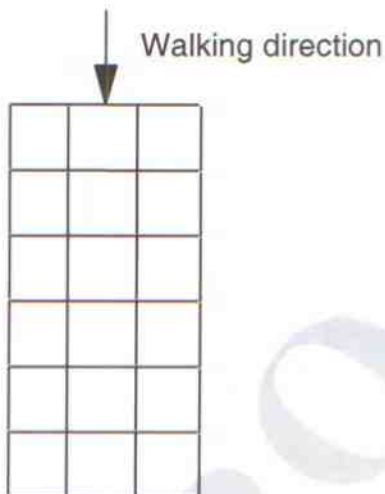

RESULTS

Average total acceptance angle:
Movement area (cm³/dm²):

22°

CLASSIFICATION (BGR 181- 10/2003)

Group of anti - slip properties:
Movement area evaluation group:

R11

Prof. Eng. Giorgio Timellini
Director