

**MODENA CENTRO PROVE s.r.l.**

Sede legale e Laboratori: 41123 Modena (Italy) - Via Sallustio, 78
Tel. 059 822417 r.a. - Fax 0598635115 - e-mail : info@modenacentroprove.it - www.modenacentroprove.com
C.C.I.A.A. Modena n. 228587 - Tribunale di Modena n° 2231 - C.F. e P. IVA n. 01592020364

MECCANICA

ECOLOGIA

CERAMICA

AUTOMOTIVE

Modena, 28/06/21

To **FLORIM CERAMICHE SPA**
VIA CANALETTO 24
41042 FIORANO MODENESE MO

Attn. **Dott. Davide Turrini**

MATERIAL and/or SAMPLE to be tested	Denomination of the Sample	Client Reference – Your delivery	date
Porcelain tiles	serie Earthtech articolo Pumice ground nat superficie Comfort formato 60x60 spessore 10 mm brand Floor gres	Ns ritiro	08/06/2021

Here attached, you will receive the Test Report of Serial No. **20214616**/n, which shows the results of tests required.

MODENA CENTRO PROVE

MODENA CENTRO PROVE

Director
Sant'Unione dr. Giuseppe



TEST REPORT: 20214616/1

Modena, 28/06/21

CUSTOMER	FLORIM CERAMICHE SPA - - VIA CANALETTO 24 - 41042 - FIORANO MODENESE - MO
MATERIAL and/o SAMPLE to be tested	Porcelain tiles;
Denomination	serie Earthtech, articolo Pumice ground nat, superficie Comfort, formato 60x60, spessore 10 mm, brand Floor gres;
Date of sample reception	08/06/2021;
Date of sample acceptance	08/06/2021;
Kind of test executed	Determination of the Resistance to Stains
Referring standards	UNI EN ISO 10545-14:2015
Shifting from standards	No one
Equipment	Luxmeter cod. MCP C69 - Forced ventilation stove cod. MCP C108
Subcontracted phases	No one
Sampling made by	Customer

The test results reported in this Test Report refer only to the sample sampled by our staff and / or given by the Customer as received.

The sample identification data were provided by the customer. Further additional information provided by the Customer will be reported in the Test Report in blue color. If the information provided by the customer influences the validity of the results, MCP declines all responsibility.

Any changes / additions made to the Test Report after its first issue will be identified by underlining the text.

The Customer undertakes to reproduce this document in its entirety. Any form of partial reproduction is prohibited.

The storage times of the samples are indicated on the offer or contract to which this Test Report refers.

 Examiner p.i. Bortolai Alberto	 MODENA CENTRO PROVE Ceramic Dept. Responsible P.I. De Pasquale Roberto	 MODENA CENTRO PROVE Director Sant'Unione dr. Giuseppe
---------------------------------------	--	---



DETERMINATION OF THE RESISTANCE TO STAINS


Beginning date : 24/06/2021

Analysis ending date : 25/06/2021

SAMPLE : Ceramic tiles, marked « serie Earthtech, articolo Pumice ground nat, superficie Comfort, formato 60x60, spessore 10 mm, brand Floor gres »

CLASSIFICATION

Classification of the Stains by Cleaning Test

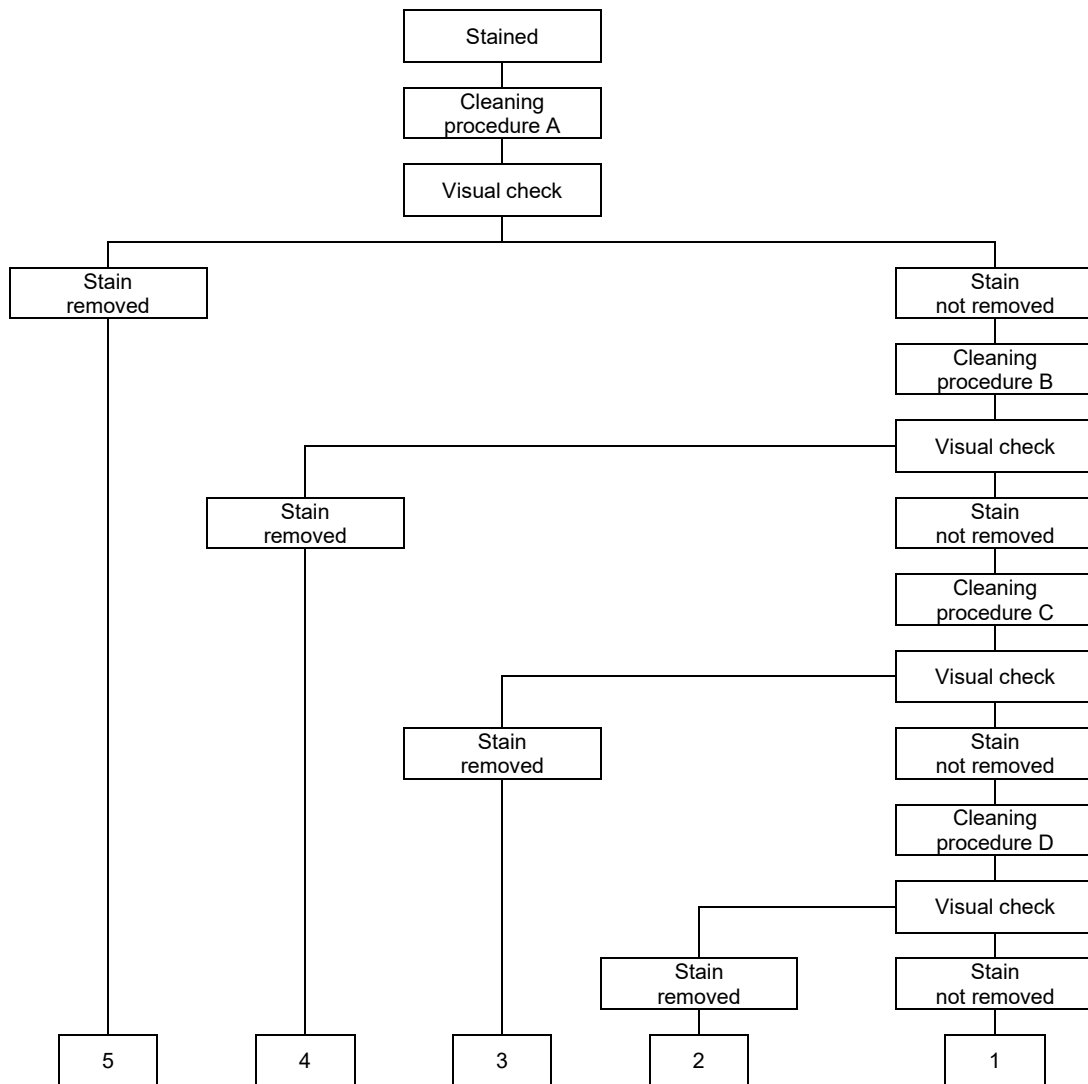

Examiner

p.i. Bortolai Alberto

MODENA CENTRO PROVE
Ceramic Dept. Responsible
P.I. De Pasquale Roberto

MODENA CENTRO PROVE
Director
Sant'Unione dr. Giuseppe

**MODENA CENTRO PROVE s.r.l.**

Sede legale e Laboratori: 41123 Modena (Italy) - Via Sallustio, 78
 Tel. 059 822417 r.a. - Fax 059380281 - e-mail : info@modenacentroprove.it -
www.modenacentroprove.com
 C.C.I.A.A. Modena n. 228587 - Tribunale di Modena n° 2231 C.F. e P. IVA n. 01592020364



LAB N°1018L

Membro degli Accordi di Mutuo Riconoscimento EA, IAF e ILAC

Signatory of EA, IAF and ILAC Mutual Recognition Agreements

RESULTS**Classification:**

Sample n°	Standing time	Staining agents	Cleaning agents						Class
			Procedure A	Procedure B	Procedure C	Procedure D			
			Hot water	Weak cleaning agent	Strong cleaning agent	Solvents			
						HCl 3%	KOH 200 g/l	ACETONE	
1	24 hours	Green staining agent in light oil	Removed						5
	24 hours	Iodine 13 g/l solution in alcohol	Removed						5
	24 hours	Olive oil	Removed						5
2	24 hours	Green staining agent in light oil	Removed						5
	24 hours	Iodine 13 g/l solution in alcohol	Removed						5
	24 hours	Olive oil	Removed						5
3	24 hours	Green staining agent in light oil	Removed						5
	24 hours	Iodine 13 g/l solution in alcohol	Removed						5
	24 hours	Olive oil	Removed						5
4	24 hours	Green staining agent in light oil	Removed						5
	24 hours	Iodine 13 g/l solution in alcohol	Removed						5
	24 hours	Olive oil	Removed						5
5	24 hours	Green staining agent in light oil	Removed						5
	24 hours	Iodine 13 g/l solution in alcohol	Removed						5
	24 hours	Olive oil	Removed						5

Examiner

p.i. Bortolai Alberto

MODENA CENTRO PROVE
Roberto De Pasquale
 Ceramic Dept. Responsible
 P.I. De Pasquale Roberto

MODENA CENTRO PROVE
Giuseppe Sant'Unione
 Director
 Sant'Unione dr. Giuseppe